


US REN23 PNEUMATIC TWO HAND CONTROL

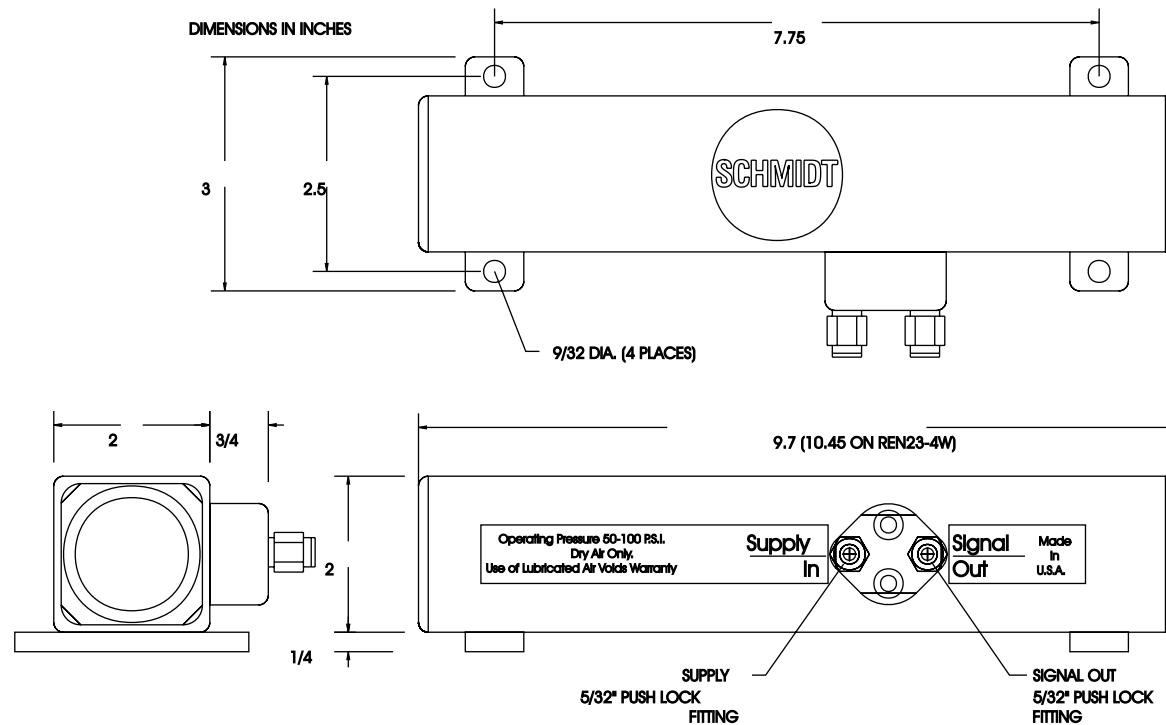

MOUNTING INSTRUCTIONS FOR SCHMIDT US REN23 CONTROLS

DO NOT USE LUBRICATED AIR. USE OF LUBRICATED AIR VOIDS WARRANTY.

THE UNIT MUST BE INSTALLED BY PERSONNEL TRAINED IN PNEUMATICS AND SAFETY PROCEDURES.
THE WORKING PRESSURE RANGE IS 50-100 PSI, 40 MICRON FILTERED DRY AIR.

MOUNT THE CONTROL USING (4) 1/4" OR #10 SCREWS. THE CONTROL MUST BE MOUNTED SECURELY.

US REN23 CONTROL

CONNECT YOUR SUPPLY LINE TO THE IN PORT. CONNECT THE SIGNAL OUT PORT TO THE PILOT PORT ON YOUR VALVE.
ALWAYS USE DRY, NON-LUBRICATED AND FILTERED AIR AS THE SUPPLY TO THIS CONTROL

WARNING: ALWAYS USE SINGLE AIR PILOT SPRING RETURN POWER VALVES. NEVER USE DOUBLE AIR PILOT VALVES.

WARNING: ALL RENCO CONTROLS ARE DESIGNED TO OPERATED PNEUMATIC OR HYDRAULIC VALVES AND CYLINDERS. THEY ARE NOT TO BE USED WITH FLYWHEEL PRESSES, BRAKE PRESSES OR SIMILAR DEVICES. IT IS THE BUYERS RESPONSIBILITY TO DETERMINE THE USE AND MOUNTING LOCATION OF THIS DEVICE. THIS EQUIPMENT PERFORMS THE FUNCTION OF A TWO HAND NO TIE DOWN CONTROL ONLY. ALL OTHER PRESCRIBED SAFETY DEVICES MUST BE USED WITH THIS EQUIPMENT. IT IS THE BUYERS RESPONSIBILITY TO DETERMINE THE PROPER APPLICATION, LOCATION AND USE OF THIS EQUIPMENT.